


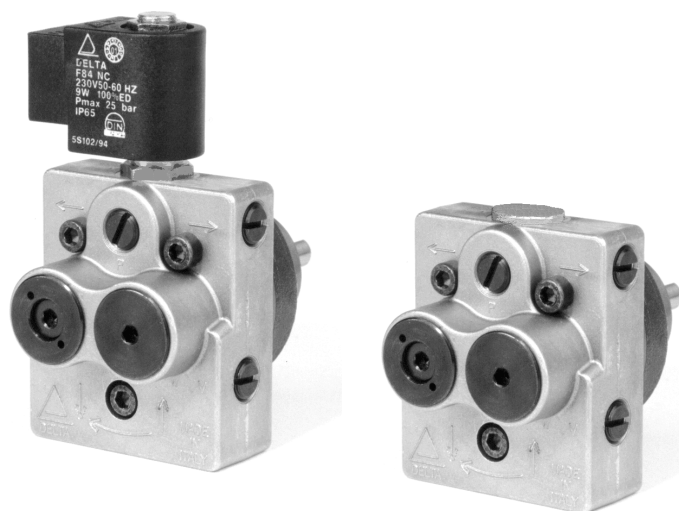

**A**  
**AD**  
**Oil burners fuel unit**

# Oil burners fuel unit

## Type A, AD

### 1- Applications

The DELTA aluminium fuel unit type A is an efficient and modern oil burner pump, provided with bilateral delivery ports. Hub and shaft sizes are manufactured to international standards (EN 225-1), so it can be fitted to every oil burner.

The pump type A is designed for pumping oil in high pressure oil burners and transfer pump applications. Its features allow an easy pump replacement with every other type of oil pump: the same unit is provided with nozzle port in both the left and right sides.

#### **⚠ WARNING**

**For the use with low viscosity fuel (lower than 2.5cSt, i.e. Kerosene) standard pump can be used without exceeding 12 bar.**


**To pump biodiesel or fuel containing it in any percentage, it is necessary the "B" version with special seals. On request the pump can be provided free of nonferrous metals.**

**This unit must not be used to pump water or acid.**

### 2- Operation

The type A fuel unit consists of a pump, solenoid valve (A type only), filter and pressure regulator. The pumping action is obtained from two spur gears (2), one of which is connected to the drive shaft (3). The aluminium pump casting provides the various oil ways, for the suction (6), return (5) and nozzle ports (9). Pressure (8) and vacuum (7) gauge ports are also provided.

On start up, the rotating gears purge the air from the suction chamber, through a vent groove in the piston to the return line in two pipe version, and through the nozzle line (after the solenoid valve opening) in one pipe version.

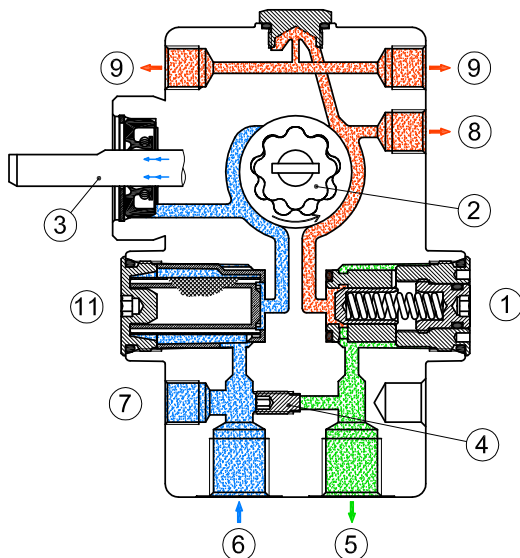

On initial commissioning, it is possible to bleed the air more quickly, through the pressure gauge port. Because a vacuum now exists oil, due to atmospheric pressure, enters the suction chamber through the filter. From the suction side, the gears pass the oil to the pressure chamber, where it comes up against the head of the piston. Due to the build up of pressure, the piston is forced back against the pressure regulating spring. In the A type the flow of pressurized oil is interrupted by an incorporated solenoid valve (10), and can, therefore, be opened following the start of the motor (pre-purge), or interrupted before stopping the motor itself (instant shut-off of the flame preventing the nozzle dripping). The excessive oil discharges to the return side (or by-passes in the one pipe version). It will be realized of course that the spring tension, which is varied by the regulating screw (1), regulates the pressure of oil required.

The AD type does not have an integrated cut-off system. When the burner motor starts, the oil will be discharged from delivery ports straight away.


#### **⚠ WARNING**

**If the AD pump is used to provide oil to the nozzle, a shut-off valve must be fitted in the nozzle line.**

The pump can be converted from the two pipe version to the single pipe version, removing the bypass plug (4) from the vacuum port.

When the unit is converted to the single pipe version, on initial commissioning the air must be bled through the pressure gauge port (in this case lift installation are not recommended).

The cartridge filter (11) located in the front side, allows an easy cleaning without to dismount any part of the unit.

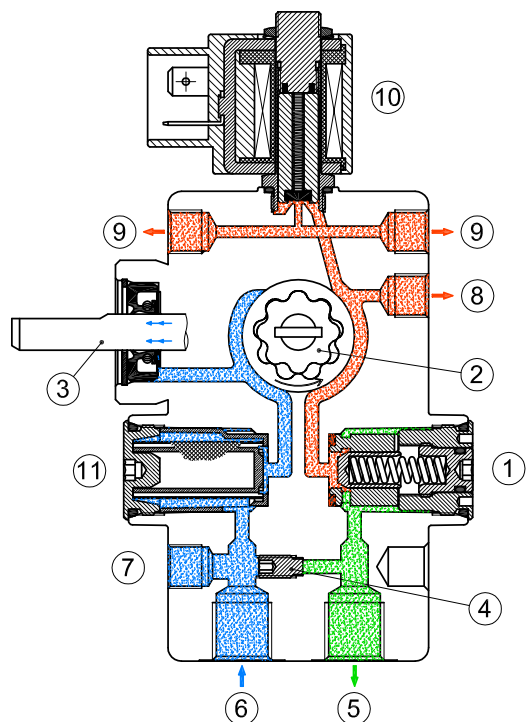

**3- Pump identification****A****1****R****2****F****A****Pump type**

A = with built-in solenoid valve  
 AD = without solenoid valve

B prefix = biodiesel version  
 (explicit request for nonferrous metals absence)

**Nozzle capacity**

(see graph)

**Rotation (seen from shaft end)**

R = clockwise  
 L = counter clockwise

**Pipes system**

1 = one pipe  
 2 = two pipes

**Coil type**

F = NF84 (coil with connector plug)

**Coil power supply**

A = 230 VAC 50/60Hz  
 B = 110 VAC 50/60Hz  
 C = 24 VAC 50/60Hz

**4- Technical specifications**

|                                 |                                                                                                        |
|---------------------------------|--------------------------------------------------------------------------------------------------------|
| Oil viscosity .....             | 1,2 ÷ 12 cSt                                                                                           |
| Oil temperature .....           | 60°C max.                                                                                              |
| Power consumption .....         | See graphs                                                                                             |
| Nozzle capacity .....           | See graphs                                                                                             |
| Fine adjustable pressure .....  | 6 ÷ 20 bar                                                                                             |
| Minimum pressure .....          | 2,5 bar (for oil transfer applications)                                                                |
| Suction line vacuum .....       | 0,5 bar max.                                                                                           |
| Suction line pressure .....     | 2 bar max.                                                                                             |
| Return line pressure .....      | 2 bar max.                                                                                             |
| Starting torque .....           | 0,1 Nm max.                                                                                            |
| Rotation speed .....            | 3500 rpm max.                                                                                          |
| Standard strainer .....         | Stainless steel mesh 130μ, 11cm <sup>2</sup>                                                           |
| Dimensions (EN 225-1) .....     | Hub Ø32, shaft Ø8                                                                                      |
| Connections (ISO 228-1) .....   | Inlet – Return : G1/4<br>Nozzle port : G1/8<br>Pressure – vacuum gauge : G1/8                          |
| Weight .....                    | A = 720 g    AD = 600 g                                                                                |
| Standard factory settings ..... | Pressure setting: 10 ±0,3 bar<br>Standard coil: 230 VAC 50/60Hz<br>Standard cable set: 3 cores, 700 mm |


**5- Solenoid valve specifications (A type only)**

|                                  |                              |
|----------------------------------|------------------------------|
| Power absorbed .....             | 9 W                          |
| Voltage tolerance .....          | -15% / +10%                  |
| Ambient temperature .....        | 0°C / 60°C                   |
| Operating pressure .....         | 25 bar max.                  |
| Flow factor (VDI/VDE 2173) ..... | 0,059 m <sup>3</sup> /h      |
| Cut-off pressure .....           | 6 bar                        |
| Approval (EN ISO 23553-1) .....  | DIN CERTCO Reg.-Nr. 5S102/09 |




## 6- Diagrams


## Nozzle capacity

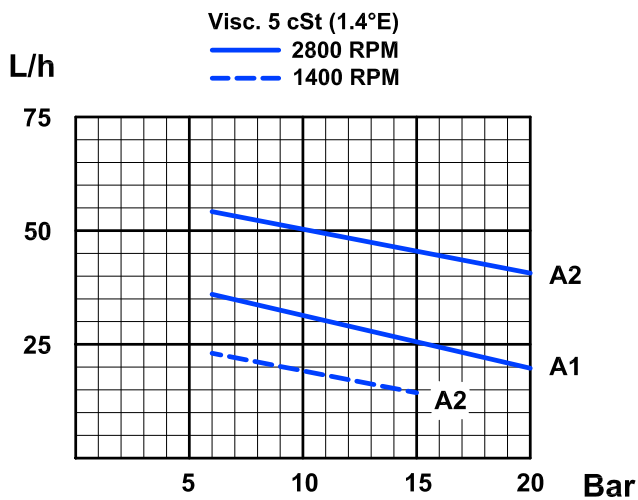

## Power consumption

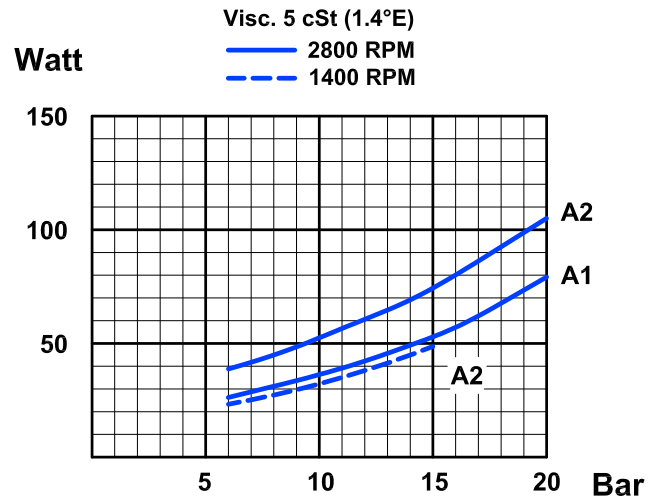

## 7- Overall dimensions

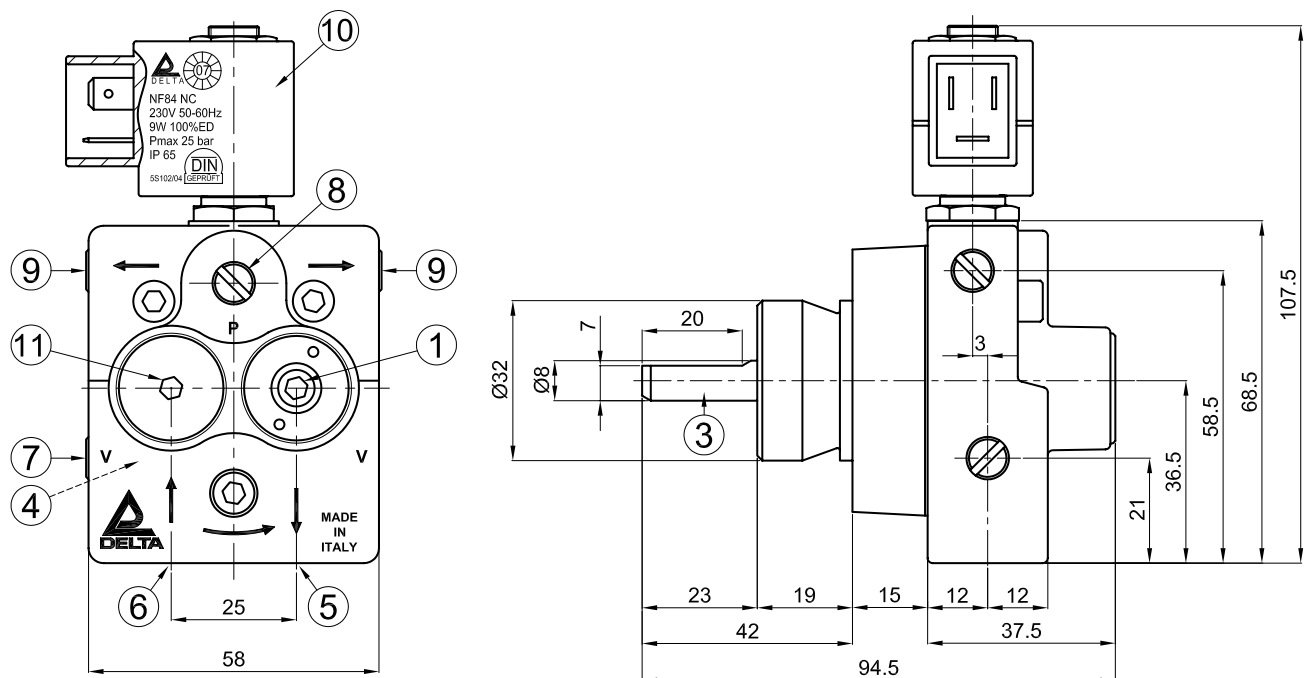

- |                       |                     |
|-----------------------|---------------------|
| 1 Pressure regulation | 8 Pressure gauge    |
| 3 Shaft sealing       | 9 Nozzle port       |
| 4 By pass             | 10 Solenoid valve   |
| 5 Return              | 11 Cartridge filter |
| 6 Suction             |                     |
| 7 Vacuum gauge        |                     |

## 8- Bypass installation

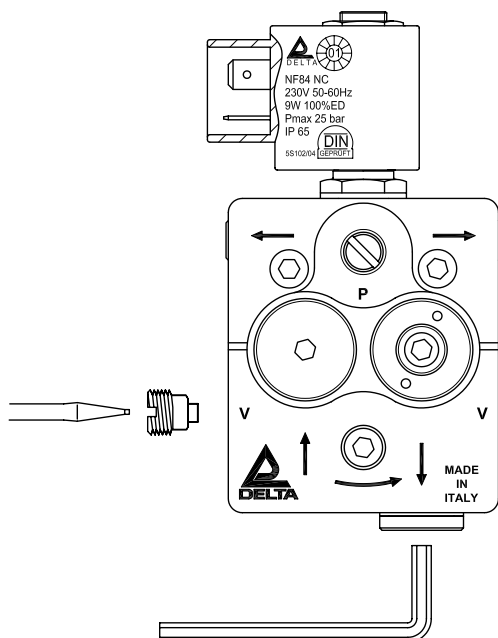


Fig. 1

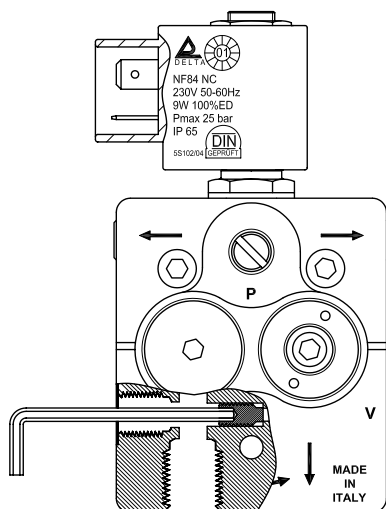


Fig. 2

**To convert the A/AD fuel unit from the single pipe version to the two pipe version, do the following:**

1. Using a 6 mm Allen wrench, remove the 1/4" plug from return port (Fig. 1).
2. Remove the 1/8" plug from vacuum port .
3. Using a 2.5 mm Allen wrench, insert and screw the bypass plug in the vacuum gauge port (Fig. 2).
4. Screw back the 1/8" plug into vacuum port.

**To convert the A/AD fuel unit from the two pipe version to the single pipe version, do the following:**

1. Remove the 1/8" plug from vacuum port .
2. Using a 2.5 mm Allen wrench, unscrew the bypass plug from the vacuum gauge port (Fig. 2).
3. Screw back the 1/8" plug in the vacuum port
4. Insert and screw a 1/4" plug into the return port (Fig. 1).

### **⚠ WARNING**

In the single pipe version, the air is bled through the nozzle line, after the solenoid valve opening.

In the two pipe version the air is bled through the return port. After conversion, the air must be bled manually, through the pressure gauge.

Make sure that the bypass plug is not used in a single pipe installation, because the fuel unit will not function properly and damage to the pump and burner motor could result.

## 9- Installation and Maintenance

1. Make sure that the bypass plug is not used in a single pipe installation.
2. Do not use fuel with additives to avoid the possible formation over time of compounds which may deposit between the gear teeth, thus obstructing them.
3. After filling the tank, wait before starting the burner. This will give any suspended impurities time to deposit on the bottom of the tank, thus avoiding the possibility that they might be sucked into the pump.
4. On initial commissioning a dry operation is foreseen for a considerable length of time (for example, when there is a long suction line to bleed). To avoid damages inject some lubrication oil into the vacuum inlet.
5. Care must be taken when installing the pump not to force the pump shaft along its axis or laterally to avoid excessive wear on the joint, noise and overloading the gears.
6. In the A type pump do not force the valve stem and do not use it as lever. If the AD pump is used to provide oil to the nozzle, a shut-off valve must be fitted in the nozzle line.
7. Pipes should not contain air pockets. The number of junctions should be kept to a minimum as they are a possible source of leakage.
8. Rapid attachment joint should therefore be avoided. Always use O-Rings or mechanical seal (copper or aluminium gaskets) junctions if possible.
9. Avoid overtightening: G1/8→15 Nm max.  
G1/4→20 Nm max.
10. Do not use PTFE tape on the suction and return line pipes to avoid the possibility that particles enter circulation. These could deposit on the pump filter or the nozzle, reducing efficiency.
11. When junction threads, elbow joints and couplings are sealed with removable glue, avoid excessive quantities, which could enter in the oil ways and damage to the pump could result.
12. To clean the filter, unscrew the plug using a 4 mm Allen wrench. Remove the cartridge from the unit and extract the inox mesh. When reassemble, cartridge must be oriented with the radial hole toward the inlet port. It must be thoroughly cleaned at least once in a season to ensure correct working of the fuel unit. An external filter should always be installed in the suction line upstream of the fuel unit.
13. Make sure the combustion chamber is free of oil or oil vapor before operating the system.
14. Protection against accidental touch of hot coil must be assured by appropriate installation.

## 10- Nozzle Pressure Test

Most nozzles ratings are based upon 100 PSIG (6,89 Bar) delivered oil pressure. The flow rate at the desired pressure must be estimated using the nozzle manufacturers data sheets. To insure that oil is delivered to the burner nozzle at the desired pressure, do the following:

1. Remove the 1/8" plug from the port marked "P" and connect a pressure gauge to this port (use a gauge of 0 to 20 Bar or greater). The "P" port (Pressure Gauge Test Port) has been provided specifically for the connection of the pressure gauge for measuring the nozzle pressure; however, when available, it is also permissible to use the vent port for measuring nozzle pressure.
2. Start the burner motor, energize the solenoid valve and vent all air from the fuel unit and connected suction line system.
3. Check the adjustable nozzle pressure range of the fuel unit, using a 4 mm Allen wrench, turning the adjusting screw counter clockwise to lower the nozzle pressure and clockwise to increase the nozzle pressure.



### WARNING

Adjust the nozzle pressure in accordance with the burner manufacturers specifications.

## 11- Nozzle Cut-Off Test (A type only)

Fuel oil is not compressible but air is. Air trapped in the nozzle line, anywhere between the fuel unit's nozzle port and the nozzle itself, will compress during burner operation. Following burner shutdown, any trapped compressed air will expand displacing the oil in the nozzle line, forcing continued oil flow through the nozzle that will, in effect, falsely appear to be poor fuel unit Cut-Off. This occurrence is particularly common with low flow rate nozzles used in conjunction with long air tubes.

To verify positive nozzle Cut-Off after burner shutdown, do the following:

1. Remove the nozzle line and fitting from the nozzle port of the fuel unit and connect a 1/8" pressure gauge to the nozzle port (a gauge of 20 Bar or greater be used). It may be more convenient to use a gauge fitted out with an extension nipple or with a line and flare nut to connect directly to the fitting installed into the nozzle port. If any type of extension is used between the nozzle port and the gauge, it should be kept as short as possible to minimize the amount of trapped air.
2. Start the burner motor, energize the solenoid valve and vent all air from the fuel unit and connected suction line system.
3. Shut off the burner motor. Initially the pressure will drop and then stabilize within a second or two. The pressure reading on the gauge should stabilize at 6 Bar or greater and hold for at least two minutes.

## 12- Vacuum Test

The vacuum test is necessary to verify the fuel unit's suction ability, to evaluate the leak tight integrity of the entire fuel unit and connected oil suction line piping system, to confirm that there are no abnormal restrictions in the oil suction line system, and, to confirm that the system vacuum is within the allowable specification limits of the unit. Please watch in any case the graphs for maximum suction line length depending on line diameter, viscosity, difference in height of suction line and pump or nozzle capacity. To perform the test, do the following:

1. Remove the 1/8" plug from the port marked "V" and connect a vacuum gauge to this port.
2. Start the burner motor, energize the solenoid valve and vent all air from the fuel unit and connected suction line system.
3. With the burner motor running, close the valve connected to the inlet port. You will note that the vacuum as measured by the vacuum gauge will increase. Allow the burner motor to continue to run until the highest vacuum reading is achieved. A fully primed fuel unit in good condition should be capable of pulling at least 0,7 Bar. If not, before condemning the fuel unit, be sure that all connections and plugs are tight and the valve is in good working order.
4. De-energize the solenoid valve and shut off the burner motor. Initially, the vacuum reading will drop and then stabilize within a second or two. Once the vacuum reading stabilizes, record the reading. If the fuel unit is free of leaks, this reading should hold constant for at least 2 minutes. If the vacuum reading drops, there is a leak that must be located and corrected.
5. When each leakage is removed and the valve onto suction line is open, check to be sure that the actual operating vacuum does not exceed 0,5 Bar.



### CAUTION

Turn off all power before servicing any part of the system.

Eletromeccanica Delta S.p.A.  
31030 Arcade (TV) Italy  
Tel. +39 0422 874068  
Fax. +39 0422 874048  
delta@deltapumps.com  
www.deltapumps.com

We reserves the right to update or make technical changes without prior notice.